
Product data sheet
Automation technology - Sensors and actuators

Product description	**M12 Female cable connector, Contacts: 5, 6.0-8.0 mm, unshielded, screw clamp, IP67, UL 2238, VDE, for the power supply**
Area	**M12-A**
Coding	**A-coded**
Series	**713**
Part no.	**99 0436 32 05**


Illustration (may vary)



Scale drawing

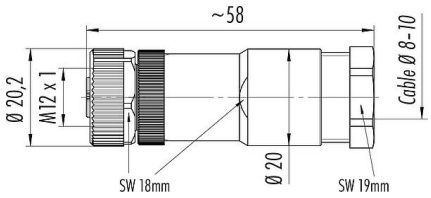

Contact arrangement (Plug-in side)

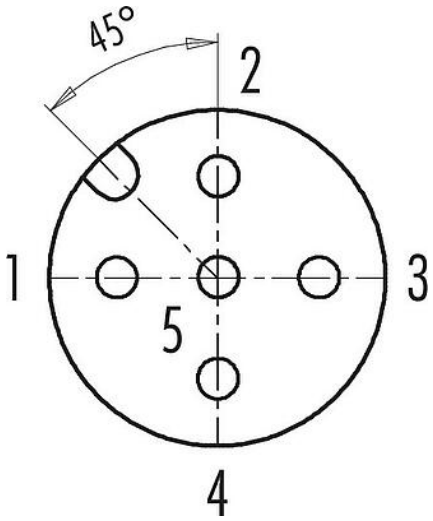

You can find the assembly instructions on the next page.

Technical data

General features

Part no.	99 0436 32 05
Connector design	Female cable connector
Type standard	DIN EN 61076-2-101
Coding	A-coded
Version	Connector socket straight
Connector locking system	screw
Termination	screw clamp
Degree of protection	IP67
Connection cross-section	max. 1.50 mm² / AWG 16
Cable outlet	6.0-8.0 mm
Temperature range from/to	-40 °C / 85 °C
Mechanical operation	> 100 Mating cycles
Weight (g)	24.61
Customs tariff number	85369010
Country of Origin	HU

Electrical parameters

Rated voltage	60 V
Rated impulse voltage	1500 V

Product data sheet

Automation technology - Sensors and actuators

Product description	**M12 Female cable connector, Contacts: 5, 6.0-8.0 mm, unshielded, screw clamp, IP67, UL 2238, VDE, for the power supply**
Area	**M12-A**
Coding	**A-coded**
Series	**713**
Part no.	**99 0436 32 05**

Rated current	4.0 A
Insulation resistance	> 10^8 Ω
Pollution degree	3
Overvoltage category	II
Insulating material group	III
EMC compliance	unshielded

Material

Housing material	PA
Contact body material	PA
Contact material	CuZn (brass)
Contact plating	Au (gold)
Locking material	Zinc die-cast nickel-plated
REACH SVHC	CAS 7439-92-1 (Lead)
SCIP number	0d36d2af-8853-439e-a3f2-211e6b041ce3

Authorization/approvals

Approvals	UL 2238, VDE

Classifications

eCl@ss 11.1	27-44-01-02
ETIM 9.0	EC002635

Declarations of conformity


Low Voltage Directive	EN 60529:1991 | EN 60204-1:2018

Product data sheet


Automation technology - Sensors and actuators

Product description	**M12 Female cable connector, Contacts: 5, 6.0-8.0 mm, unshielded, screw clamp, IP67, UL 2238, VDE, for the power supply**
Area	**M12-A**
Coding	**A-coded**
Series	**713**
Part no.	**99 0436 32 05**

Assembly instructions

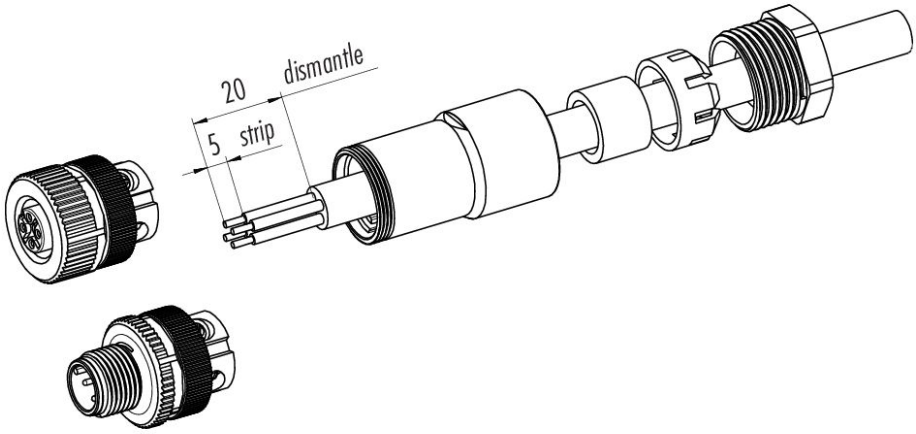

Derating curve

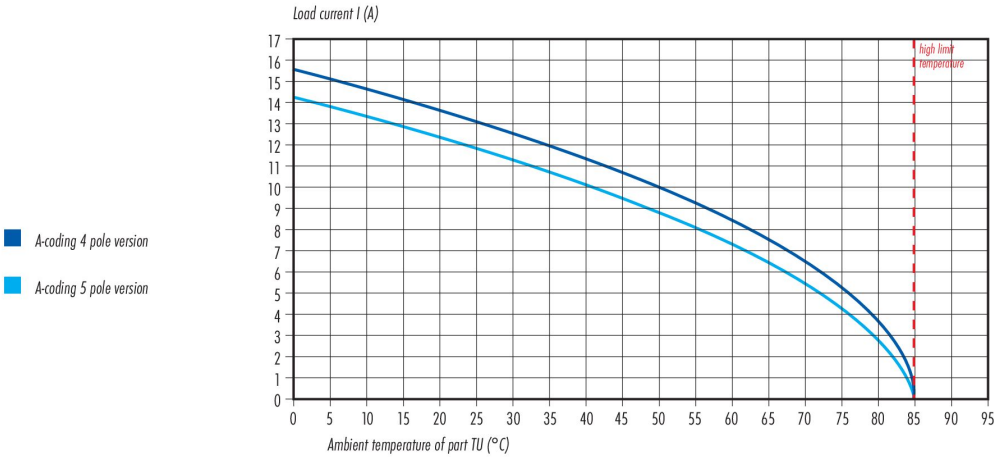

Product data sheet

Automation technology - Sensors and actuators

Product description	**M12 Female cable connector, Contacts: 5, 6.0-8.0 mm, unshielded, screw clamp, IP67, UL 2238, VDE, for the power supply**
Area	**M12-A**
Coding	**A-coded**
Series	**713**
Part no.	**99 0436 32 05**

Security notices

The connector must not be plugged or unplugged under load. Non-observance and improper use can result in personal injury.

The connectors have been developed for applications in plant engineering, control and electrical equipment construction. The user is responsible for checking whether the connectors can also be used in other areas of application.

To protect against unintentional opening of the connector, the thread between the housing and the connector head must be secured with a suitable cyanoacrylate adhesive when used in circuits with voltages dangerous to the touch. This does not apply to connectors used in SELV and PELV circuits according to IEC 61140 (EN 61140, VDE 0140-1).

Connectors which are used in circuits with voltages dangerous to the touch may only be installed and used by, or under the supervision of, persons with electrical engineering training, taking into account the applicable regulations and standards.

The user must take suitable safety precautions to ensure that the connector cannot be accidentally disconnected.

Plug connectors with enclosure protection IP67 and IP68 are not suitable for use under water. When used outdoors, the plug connectors must be protected separately against corrosion. For further information on the IP protection classes, please refer to the "Technical Information" download centre.

To lock the cable connector with the device connector, the threaded ring is tightened "hand-tight" (approx. 60 cNm).

The user must take appropriate safety precautions to ensure that the connector cannot be accidentally disconnected. In addition, the user must ensure that the cable is suitably secured.